

**Source:** Prestolite Leece-Neville Heavy Duty Systems  
**Bulletin No:** TSB-1226 **Date:** May 2, 2023  
**Models:** 8LHA2170VF (110-555JHO)  
**Subject:** Terminal ID from 110-555JHO to AVI555P



techservice@prestolite.com


This document will help identify terminal location variances.

**Note:** Wire terminations and routing may require changes.

AVI555P has internal cooling fans. External fan used on 110-555PHO alternator is not needed.

Both AVI555P and 110-555PHO are self-excited machines.

AVI555P is case ground where the 110-555PHO is insulated return.

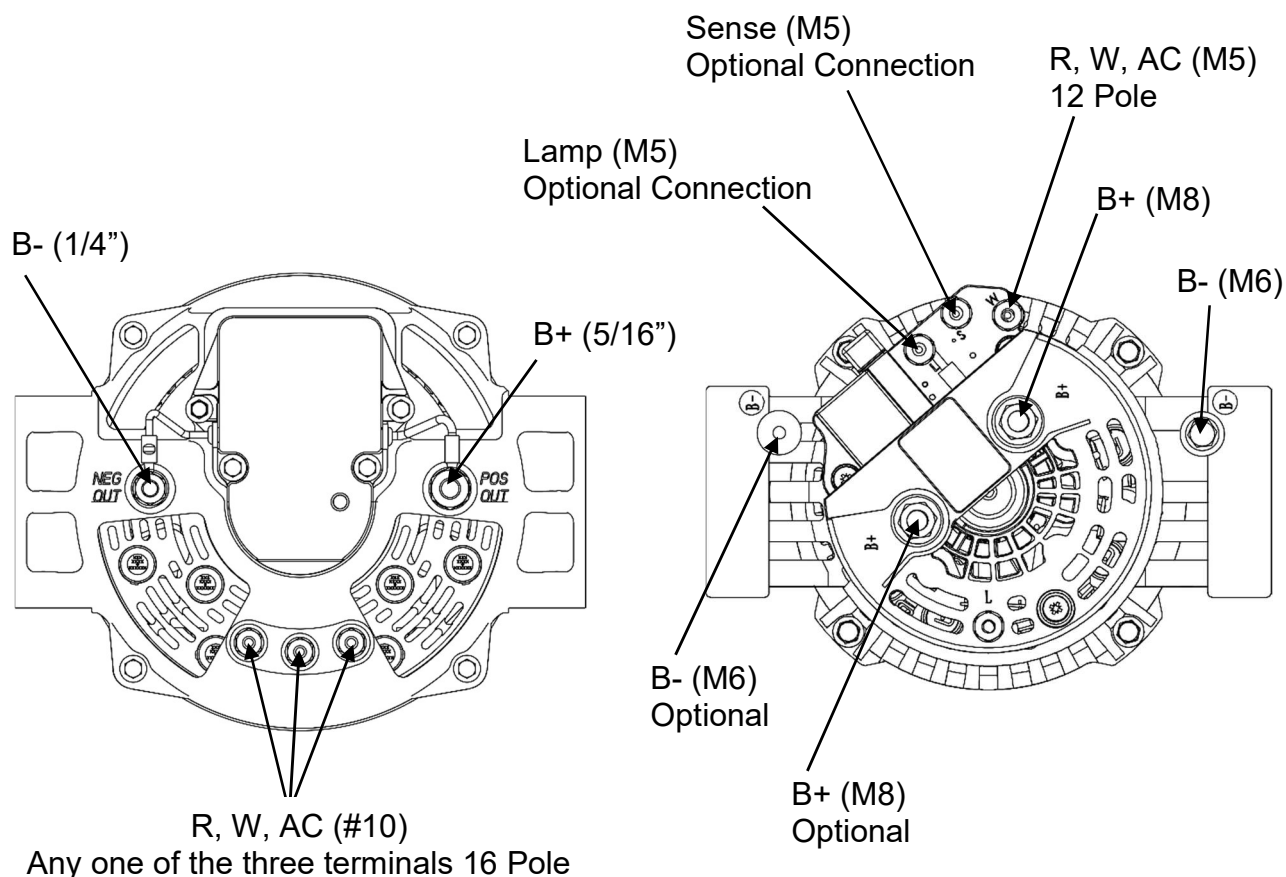

**Important:** The information contained in this bulletin is intended for use by trained, professional technicians who have the proper tools, equipment, and training to perform the required maintenance described above. This information is NOT intended for 'do-it-yourselfers', and you should not assume that this information applies to your equipment. If you have any questions regarding this information please visit our website at [www.prestolite.com](http://www.prestolite.com), or contact our technical service department at:

